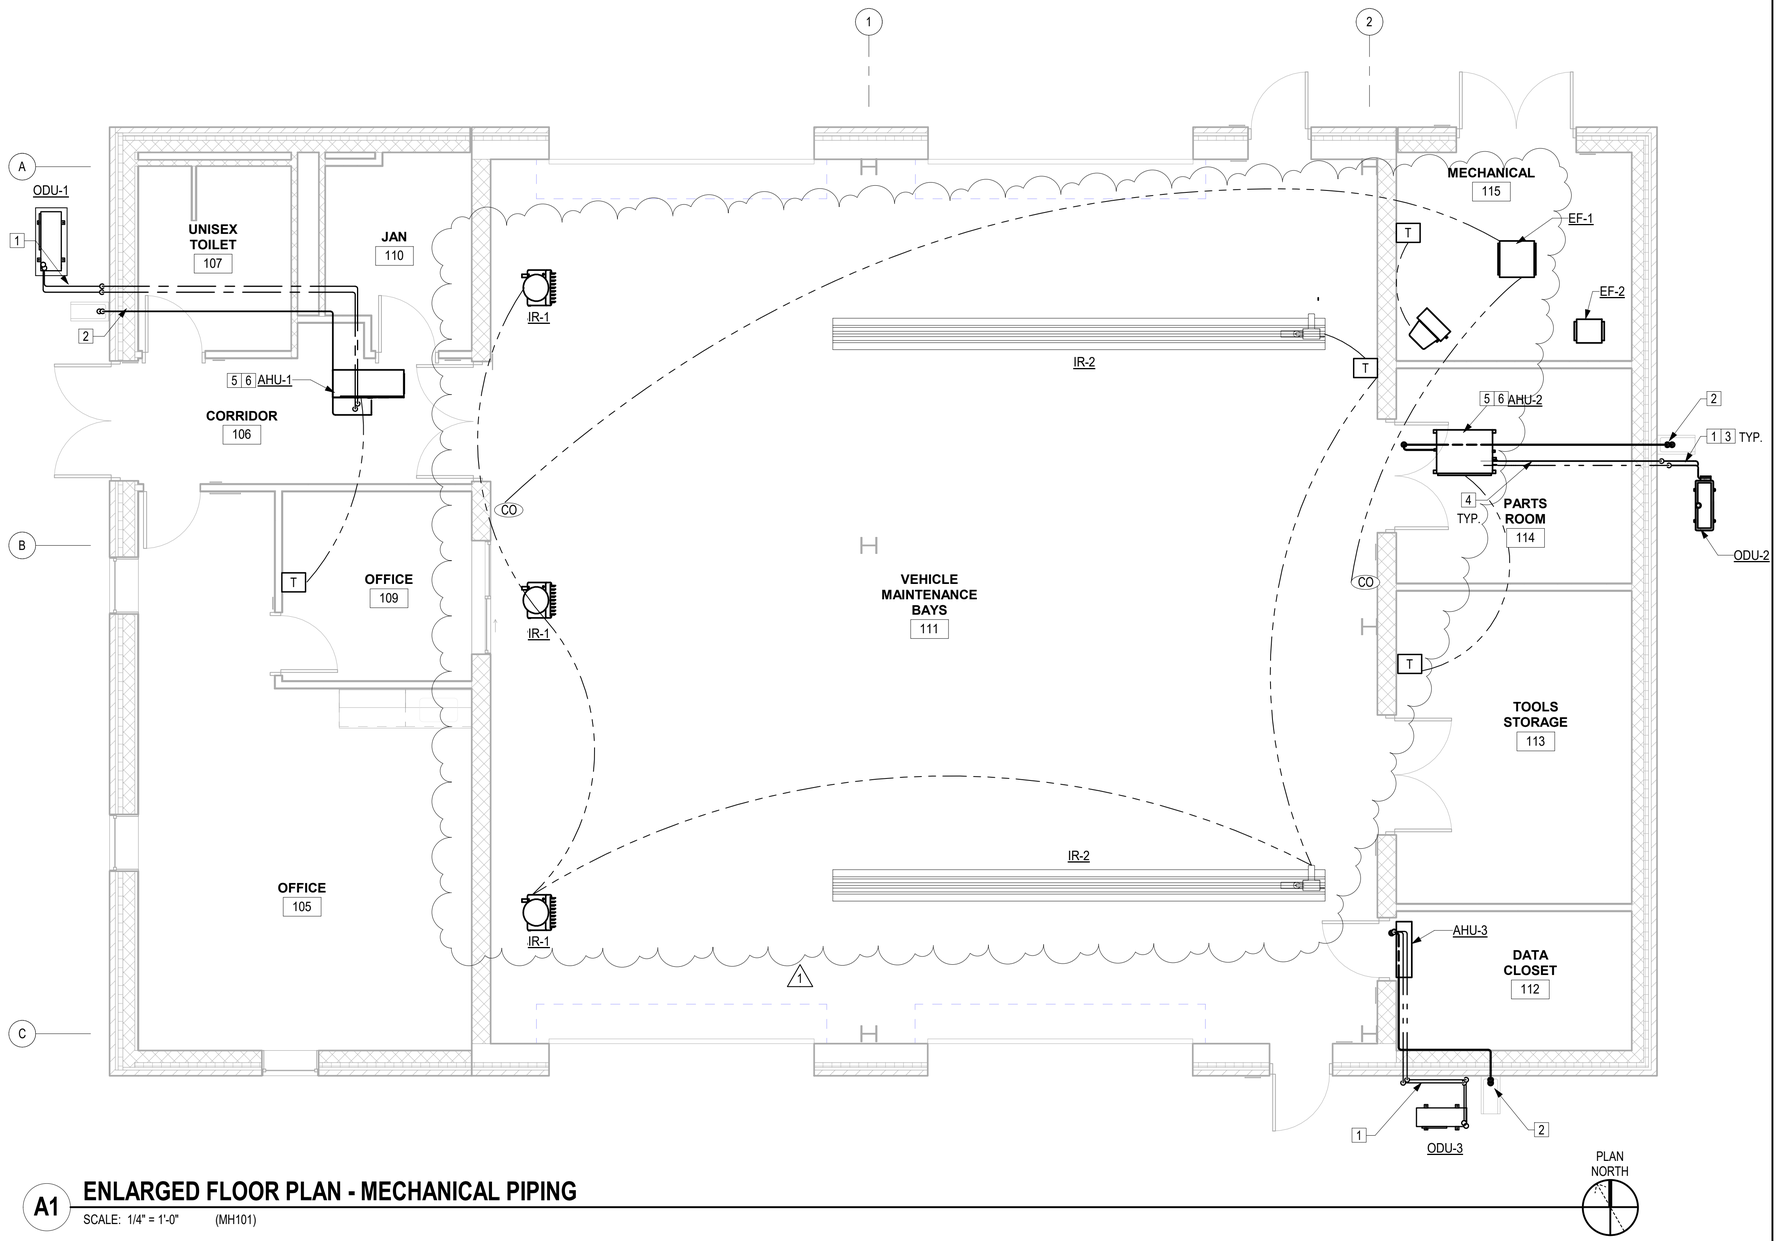


A1 ENLARGED FLOOR PLAN - MECHANICAL PIPING

SCALE: 1/4" = 1'-0" (MH101)

KEYNOTES

X

1 RL/S LINES TO INDOOR UNIT. SIZE LINES PER MANUFACTURER'S INSTRUCTIONS.
2 CONDENSATE LINE FROM INDOOR UNIT, DRAIN TO SPLASH BLOCK.
3 SEE DETAIL A1 - EXTERIOR WALL PENETRATION, SHEET P-502.
4 SEE DETAIL B4 - PIPE SUPPORT HORIZONTAL, SHEET P-501.
5 SEE DETAIL B1 - AIR HANDLING UNIT DETAIL, SHEET M-502.
6 SEE DETAIL A1 - CONDENSATE P-TAP DETAIL, SHEET M-502.

GRAPHIC SCALE(S)

1/4" = 1' - 0" 0 1' 5' 10' 15'

SYM	Revision 1	DESCRIPTION	Date 1	DATE	APPR
1					

SEAL

A/E INFO

APPROVED

FOR COMMANDER NAVFAC

ACTIVITY

Approved by LtCol Roger Holiday, Director I&E, MCAS New River

SATISFACTORY TO DATE 06/14/2021

DES DJG | DRW DJG | CHK MJH

PM/DM GFS/LEJ

BRANCH MANAGER SCW

CHIEF ENG/ARCH EA

FIRE PROTECTION DSN

DEPARTMENT OF THE NAVY
NAVAL FACILITIES ENGINEERING COMMAND
MIDLANT DC CORE

NAVAL FACILITIES ENGINEERING COMMAND
NAVAL STATION - NORFOLK, VA

MCAS NEW RIVER
JACKSONVILLE, NORTH CAROLINA

P-685 MACS-2 AUTOMOTIVE ORGANIZATIONAL SHOP

ENLARGED FLOOR PLAN - MECHANICAL PIPING

SCALE: AS NOTED

EPROJECT NO.: 1672404

CONSTR. CONTR. NO.

NAVFAC DRAWING NO. 12842320

SHEET 93 OF 119

M-402

DRAWFORM REVISION: 7 FEBRUARY 2019